

# ANSI/NFSI B101.3-2012 Report

Material:  
ALUMAMAX#7614 WET  
DCOF

Regan Scientific Instruments

05/24/2018, 8:48AM

Method: DCOF  
Facility: 001  
Location: 001  
Result: 0.63  
Distance: 04 in.  
Temp/Hum: 72 F, 50%




1.



4.


1. Avg = 0.61, Min = 0.58, Max = 0.62

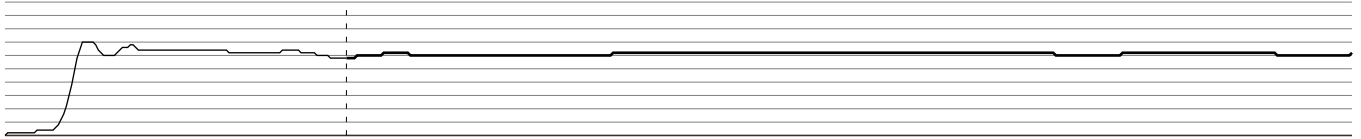


2. Avg = 0.57, Min = 0.54, Max = 0.60




3. Avg = 0.61, Min = 0.60, Max = 0.66

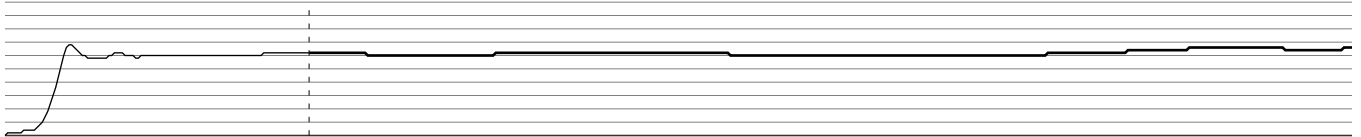


4. Avg = 0.65, Min = 0.61, Max = 0.67

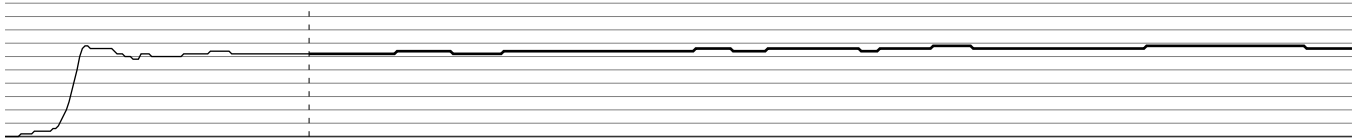

5. Avg = 0.65, Min = 0.61, Max = 0.69

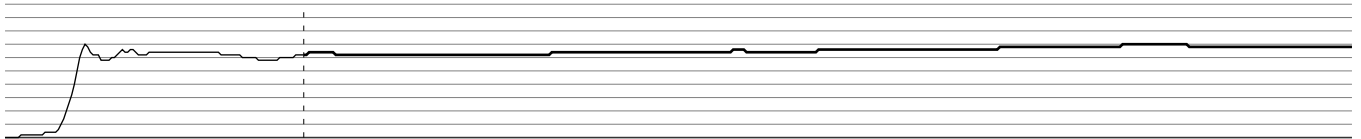

6. Avg = 0.68, Min = 0.61, Max = 0.72

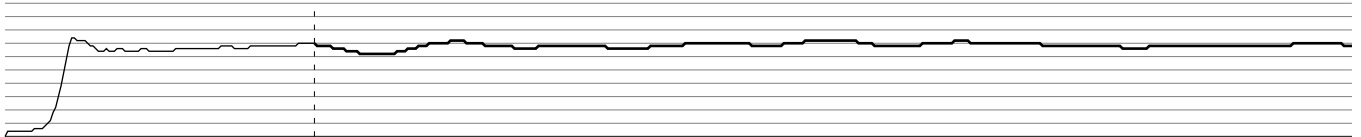

Device: BOT-3000E (v2.02.03)  
Serial No: 00329  
Calibration: 08/11/2017  
Verification: 05/02/2018, 3:28PM PASS  
Meter: 40.4 hrs

Sensor: 00770  
Type: Rubber  
Manuf. date: 10/31/2013  
Ref. offset: ----